

## TEST REPORT

for

**Rose Brand<sup>®</sup> Wipers, Inc. a/k/a Rose Brand**  
4 Emerson Lane  
Secaucus, NJ 07094  
Bob Bertrand / 201-809-6367

**Sound Absorption Testing**  
ASTM C 423-17/ E795-16

On


**22 oz. ReVive drape, 8' high x 9' wide,  
100% full, open top hem (pocket)  
Type G Mounting**

Report Number: NGC 4020005

Assignment Number: G-1679

Test Date: 02/20/2020

Report Approval Date: 03/02/2020

Submitted by:   
Anthony J. Rivers  
Test Technician

Reviewed by:   
Robert J Menchetti  
Director

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP, NIST or any agency of the Federal Government. This report may not be reproduced except in full, without written approval of the laboratory.



## Acoustical Testing Laboratory



Accredited by the National Voluntary  
Laboratory Accreditation Program for  
the specific scope of accreditation.

NGC 4020005  
Rose Brand Wipers, Inc. a/k/a Rose Brand  
03/02/2020  
Page 2 of 5

### Revision Summary:

Date	SUMMARY
Approval Date: 03/02/2020	Original issue date: 03/02/2020 Original NGCTS report: NGC 4020005

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP, NIST or any agency of the Federal Government. This report may not be reproduced except in full, without written approval of the laboratory.

Report Number: NGC 4020005

Test Method: This test method conforms explicitly with the American Society for Testing and Materials Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method - Designation: C 423-17/ E795-16.

For the test, a Linear Averaging Mode is used as the Averaging Algorithm when measuring the Decay Times.

Specimen Description: Designated by client as: 22 oz. ReVive drape, 8' high x 9' wide, 100% full,  
open top hem (pocket)

The test specimen was observed to have the following characteristics:

Drape Identification: 22 oz. ReVive drape, 8' high x 9' wide, 100% full,  
open top hem (pocket)

Fullness: 100%

All weights and dimension are averaged:

Measured dimensions: 2743.2 mm x 2438.4 mm (108 in. x 96 in.)

Weight: 0.62 kg/m<sup>2</sup> (0.13 PSF)

Unit Size: 1 Unit, 2743.2 mm x 2438.4 mm (108 in. x 96 in.)

Mounting: Type G-100 as per ASTM E795-16. For this testing, the metal G Mount frame was spaced 4 inches from the test chamber wall.

Total Sample Size: 72.00 Sq. Ft. (6.689 m<sup>2</sup>)

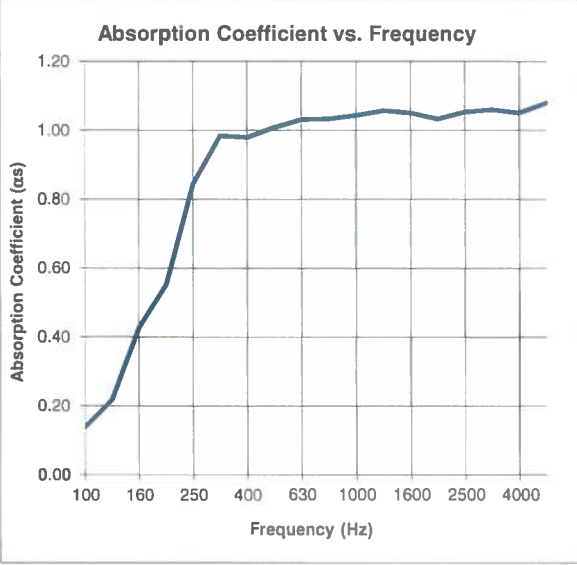
Preconditioning: Minimum 24 hours at 70°F, 55% R.H

Test Results: The results of the tests are given on pages 4 and 5 of the report.

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP, NIST or any agency of the Federal Government. This report may not be reproduced except in full, without written approval of the laboratory.

Sound Absorption Test Data per C423 - 17					Page 4 of 5
No. of test report:		NGC4020005		Date of test: 2/20/2020	
Temp. [°C]: 25.0		Humidity [%]: 50		Spec. Size [m <sup>2</sup> ]: 6.689	
Frequency [Hz]	Absorption Coefficients a <sub>s</sub>	Avg. Decay Rate		Empty d (empty) [dB/s]	Specimen d (specimen) [dB/s]
100	0.14	9.19	10.42		
125	0.22	9.84	11.78		
160	0.43	7.90	11.70		
200	0.55	8.04	12.95		
250	0.85	7.68	15.21		
315	0.98	6.96	15.74		
400	0.98	6.76	15.49		
500	1.01	6.72	15.71		
630	1.03	6.54	15.73		
800	1.03	6.17	15.39		
1000	1.04	6.43	15.73		
1250	1.06	6.50	15.93		
1600	1.05	6.53	15.91		
2000	1.03	6.52	15.73		
2500	1.05	5.74	15.14		
3150	1.06	3.48	12.93		
4000	1.05	0.08	9.45		
5000	1.08	-5.03	4.60		
Reverberation Room Volume:		282.1		m <sup>3</sup>	
<b>Noise Reduction Coefficient NRC:</b>		<b>1.00</b>		Avg. 250, 500, 1000, 2000 Hz: <b>0.983</b>	
<b>Sound Absorption Average SAA:</b>		<b>0.97</b>		Avg. 200 - 2500 Hz: <b>0.973</b>	
NOTE: Estimates of repeatability and reproducibility for sound absorption coefficients of a specimen are referenced in ASTM C423 - 17 test method.					

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP, NIST or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.

Sound Absorption Test Data per C423 - 17		Page 5 of 5																																					
Test report:	NGC4020005																																						
Date of test:	2/20/2020																																						
Spec. Size [m <sup>2</sup> ]:	6.689																																						
Room Vol.[m <sup>3</sup> ]:	282.1																																						
Temp. [°C]:	25.0																																						
Humidity [%]:	50																																						
<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 60%;"><b>Noise Reduction Coefficient NRC:</b></td> <td style="text-align: right;"><b>1.00</b></td> </tr> <tr> <td><b>Sound Absorption Average SAA:</b></td> <td style="text-align: right;"><b>0.97</b></td> </tr> </table>			<b>Noise Reduction Coefficient NRC:</b>	<b>1.00</b>	<b>Sound Absorption Average SAA:</b>	<b>0.97</b>																																	
<b>Noise Reduction Coefficient NRC:</b>	<b>1.00</b>																																						
<b>Sound Absorption Average SAA:</b>	<b>0.97</b>																																						
<table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th style="width: 50%;">Frequency [Hz]</th> <th style="width: 50%;">Absorption Coefficients <math>\alpha_w</math></th> </tr> </thead> <tbody> <tr><td>100</td><td>0.14</td></tr> <tr><td>125</td><td>0.22</td></tr> <tr><td>160</td><td>0.43</td></tr> <tr><td>200</td><td>0.55</td></tr> <tr><td>250</td><td>0.85</td></tr> <tr><td>315</td><td>0.98</td></tr> <tr><td>400</td><td>0.98</td></tr> <tr><td>500</td><td>1.01</td></tr> <tr><td>630</td><td>1.03</td></tr> <tr><td>800</td><td>1.03</td></tr> <tr><td>1000</td><td>1.04</td></tr> <tr><td>1250</td><td>1.06</td></tr> <tr><td>1600</td><td>1.05</td></tr> <tr><td>2000</td><td>1.03</td></tr> <tr><td>2500</td><td>1.05</td></tr> <tr><td>3150</td><td>1.06</td></tr> <tr><td>4000</td><td>1.05</td></tr> <tr><td>5000</td><td>1.08</td></tr> </tbody> </table>	Frequency [Hz]	Absorption Coefficients $\alpha_w$	100	0.14	125	0.22	160	0.43	200	0.55	250	0.85	315	0.98	400	0.98	500	1.01	630	1.03	800	1.03	1000	1.04	1250	1.06	1600	1.05	2000	1.03	2500	1.05	3150	1.06	4000	1.05	5000	1.08	
Frequency [Hz]	Absorption Coefficients $\alpha_w$																																						
100	0.14																																						
125	0.22																																						
160	0.43																																						
200	0.55																																						
250	0.85																																						
315	0.98																																						
400	0.98																																						
500	1.01																																						
630	1.03																																						
800	1.03																																						
1000	1.04																																						
1250	1.06																																						
1600	1.05																																						
2000	1.03																																						
2500	1.05																																						
3150	1.06																																						
4000	1.05																																						
5000	1.08																																						

The results reported above apply to specific samples submitted for measurement. No responsibility is assumed for performance of any other specimen. The laboratory's accreditation or any of its test reports in no way constitute or imply product certification, approval, or endorsement by NVLAP, NIST or any agent of the U.S. Government. This report may not be reproduced except in full, without written approval of the laboratory.